



MATCH LINE - SEE DRAWING LDP-3 FOR CONTINUATION

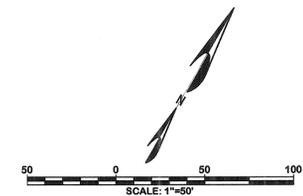

MATCH LINE - SEE DRAWING LDP-5 FOR CONTINUATION

Q:\ELECTRICAL\01 CLIENTS\Aiken\010 Runway 7-25 and Taxiway Lighting\DWG-SINGLE PHASE\AW-RWD\DWG PLAN.dwg, Last Modified: May 24, 2011 - 9:38am Plotted on: May 24, 2011 - 9:46am by TWhite

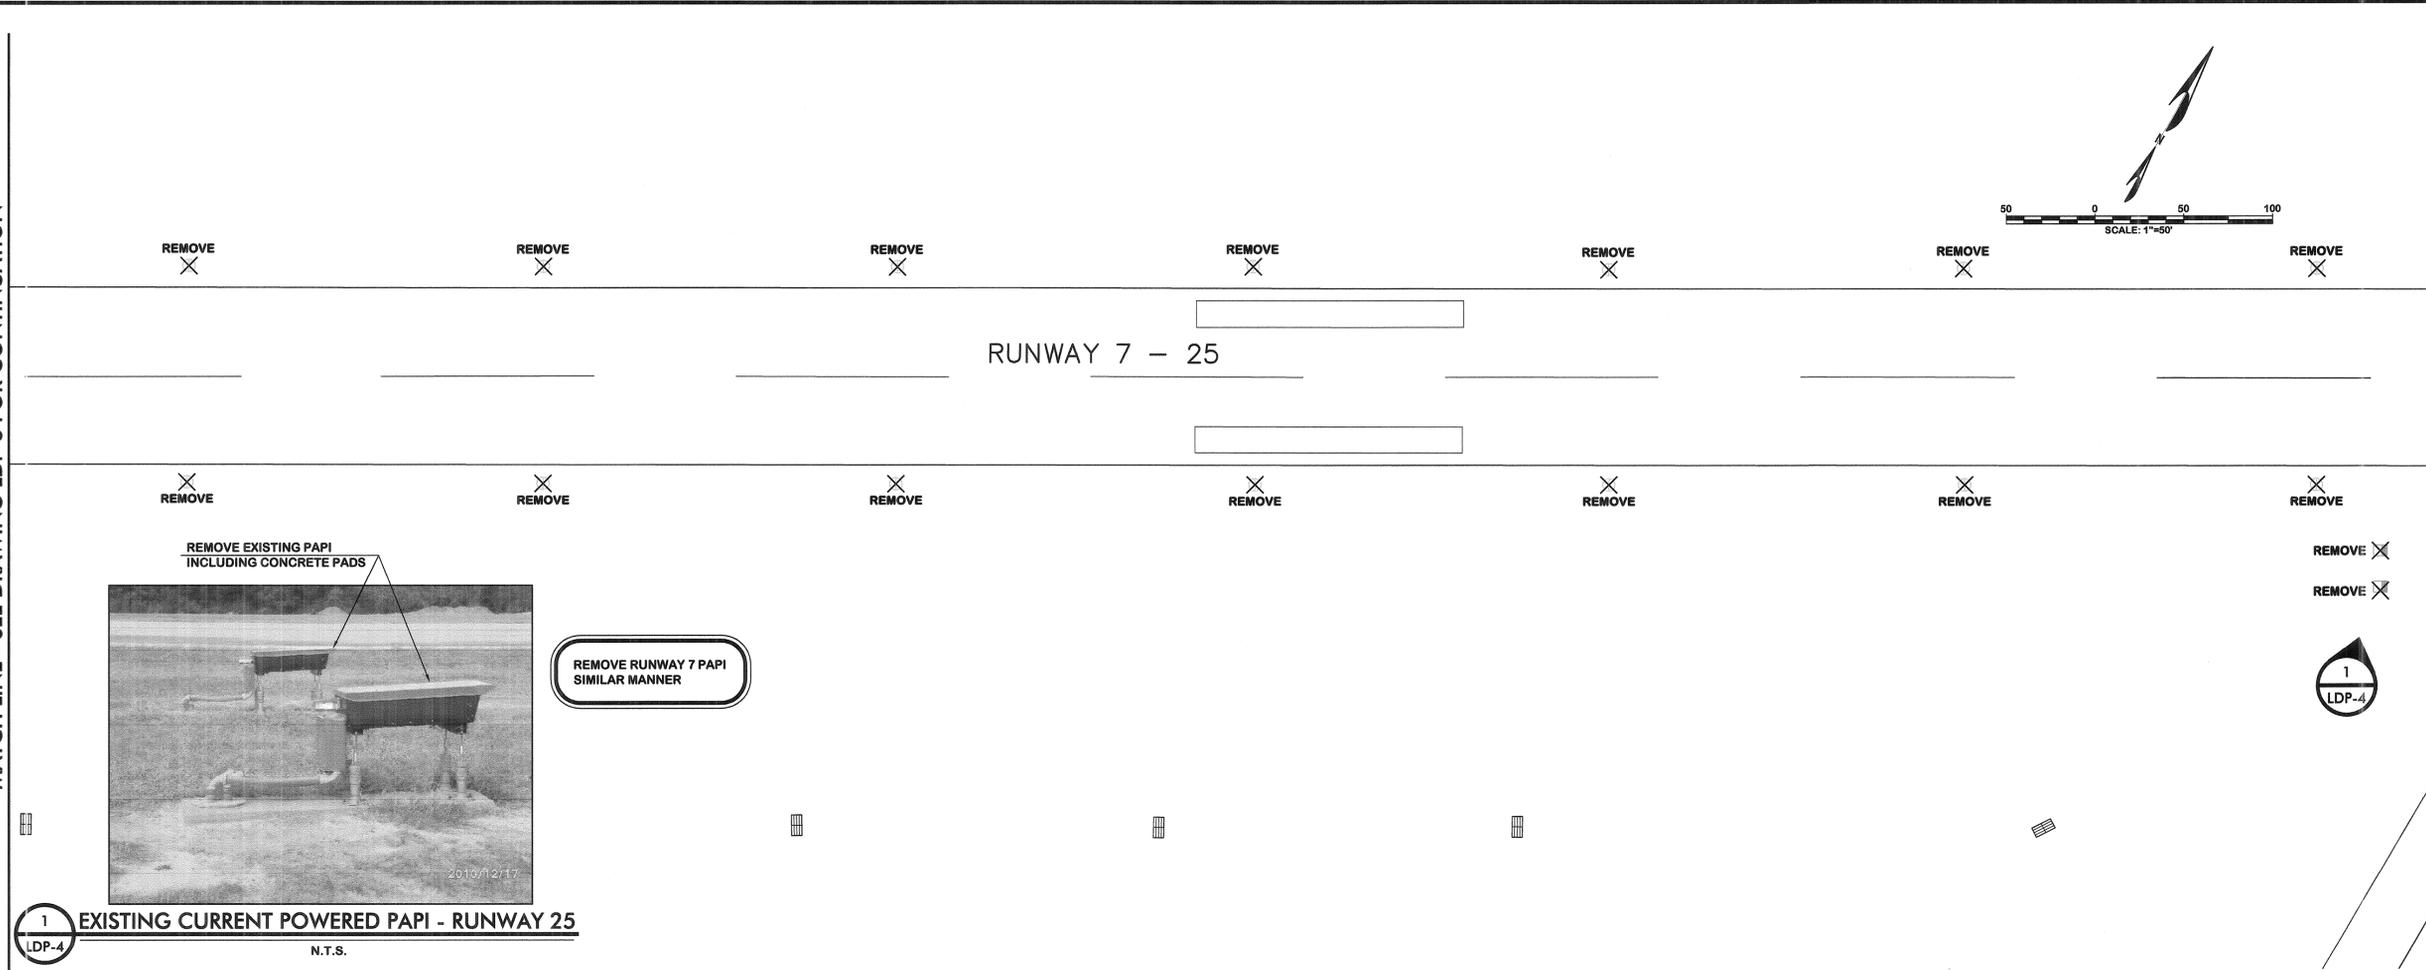


**AIKEN MUNICIPAL AIRPORT**  
AIKEN, SOUTH CAROLINA



ATLANTA, GA BATON ROUGE, LA CHARLESTON, SC CHARLOTTE, NC  
CHICAGO, IL COLUMBIA, SC GREENSBORO, NC GULFPORT, MS  
JACKSONVILLE, FL KNOXVILLE, TN MOBILE, AL ORLANDO, FL  
RALEIGH, NC RICHMOND, VA SARASOTA, FL TALLAHASSEE, FL  
TAMPA, FL WEST PALM BEACH, FL



Designer: FME/RES	Checked by: GHL
Technician: MTW	Project Number: 05500005

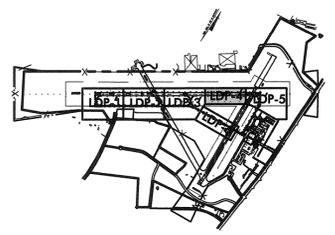

**KEY PLAN**

**REVISIONS**

No.	Description	Date	By

Project Name:  
**AIRFIELD LIGHTING REHABILITATION**

Drawing Name:  
**LIGHTING DEMOLITION PLAN NO. 4**

FAA A.I.P. Project Number:  
**3-45-0002-12-2010 & -14-2011**

Date: **MAY, 2011** Division: **AIRPORTS**

Scale: **1"=50'** Sheet Number:

Drawing Number:  
**LDP-4**

**LIGHTING DEMOLITION NOTES**

A. DO NOT SCALE THESE DRAWINGS. DIMENSIONS SHALL BE VERIFIED FROM ACTUAL FIELD CONDITIONS. THE CONTRACTOR SHALL FIELD VERIFY ALL EXISTING CONDITIONS.

B. ALL LIGHT FIXTURES, SIGNS, ISOLATION TRANSFORMERS, TRANSFORMER BASES AND CABLE IN CONDUIT, AND EQUIPMENT RENDERED USELESS BY THIS WORK SHALL BE REMOVED AND DELIVERED TO THE AIRPORT STORAGE FACILITY AS DIRECTED. CONCRETE PADS AND ANY MATERIAL NOT WANTED BY THE AIRPORT SHALL BE PROPERLY DISPOSED OF BY THE CONTRACTOR OFF OF AIRPORT PROPERTY.

C. DO NOT DISTURB OR DAMAGE ANY EXISTING CONDUITS, CABLES, DUCT BANKS, LIGHTS, OR EQUIPMENT THAT ARE NOT IN THE SCOPE OF THIS PROJECT. ANY CIRCUITS DAMAGED BY THE CONTRACTOR SHALL BE REPAIRED BY THE CONTRACTOR TO THE OWNERS SATISFACTION AT NO ADDITIONAL COST TO THE OWNER.

D. EXISTING LIGHTING SYSTEMS WITHIN THE WORK LIMITS OF THIS CONTRACT MUST BE MAINTAINED THROUGHOUT THE CONSTRUCTION PERIOD. THE CONTRACTOR SHALL BE PERMITTED TO USE EXISTING LIGHTS AND CABLES AS NECESSARY TO MAINTAIN OPERATION OF CIRCUITS. NO SEPARATE PAYMENT WILL BE MADE FOR TEMPORARY LIGHTING.